


MPS 1Ø UNDERGROUND SERVICES

In the interest of long-term economics and increased reliability of our underground distribution network, effective January 1, 1991 MPS will change its policy concerning installation of underground services. Specifications and pricing will remain unchanged for 200 amp services, with the exception that services must be installed in 2.5 inch Schd. 40 conduit. MPS will now use 350 MCM Al. triplexed cable for 400 amp services. These services will require the use of 4 inch Schd. 40 conduit. Cost to the customer for 400 amp installations will increase to \$50.00, plus \$2.00/foot from the pole to the service entrance. Underground services to padmounted equipment are subject to the per foot charge only.

All conduit will be furnished and installed by the customer at a depth of 36 inches along a route pre-approved by MPS Engineering Department. A nylon string should also be installed in the conduit. In the event that a service has an excessive number of turns, making wire pulling difficult, a larger conduit size may be required.

Thanks for your cooperation.

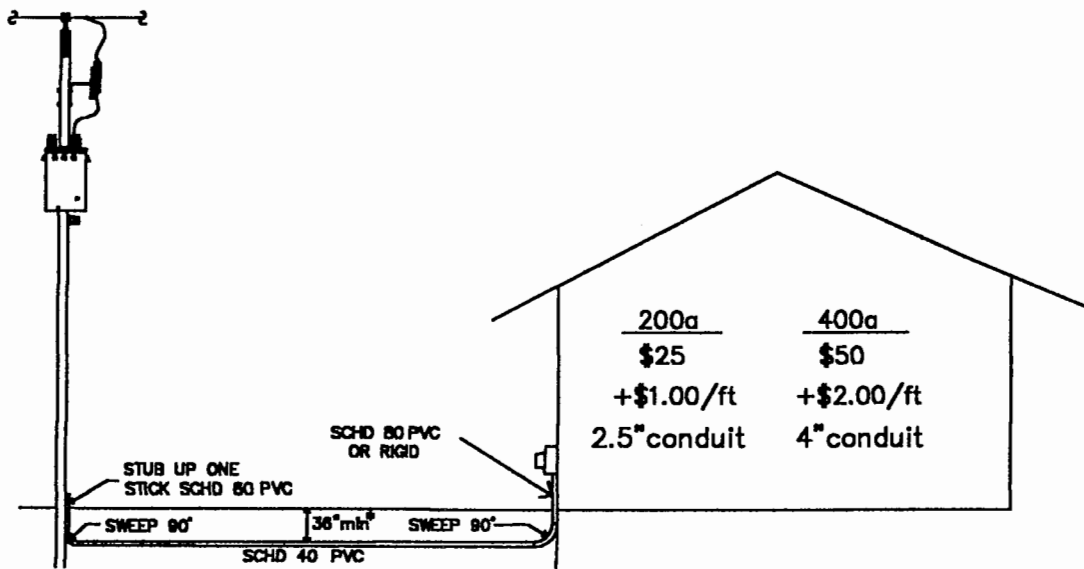

* see Morristown City Ordinance # 2415